

PARTICLE SIZE DISTRIBUTION TEST


BS EN 933-1. 1997

By Washing and Sieving

Sample Number: 1

Classification Type: 20/40mm

20/40mm

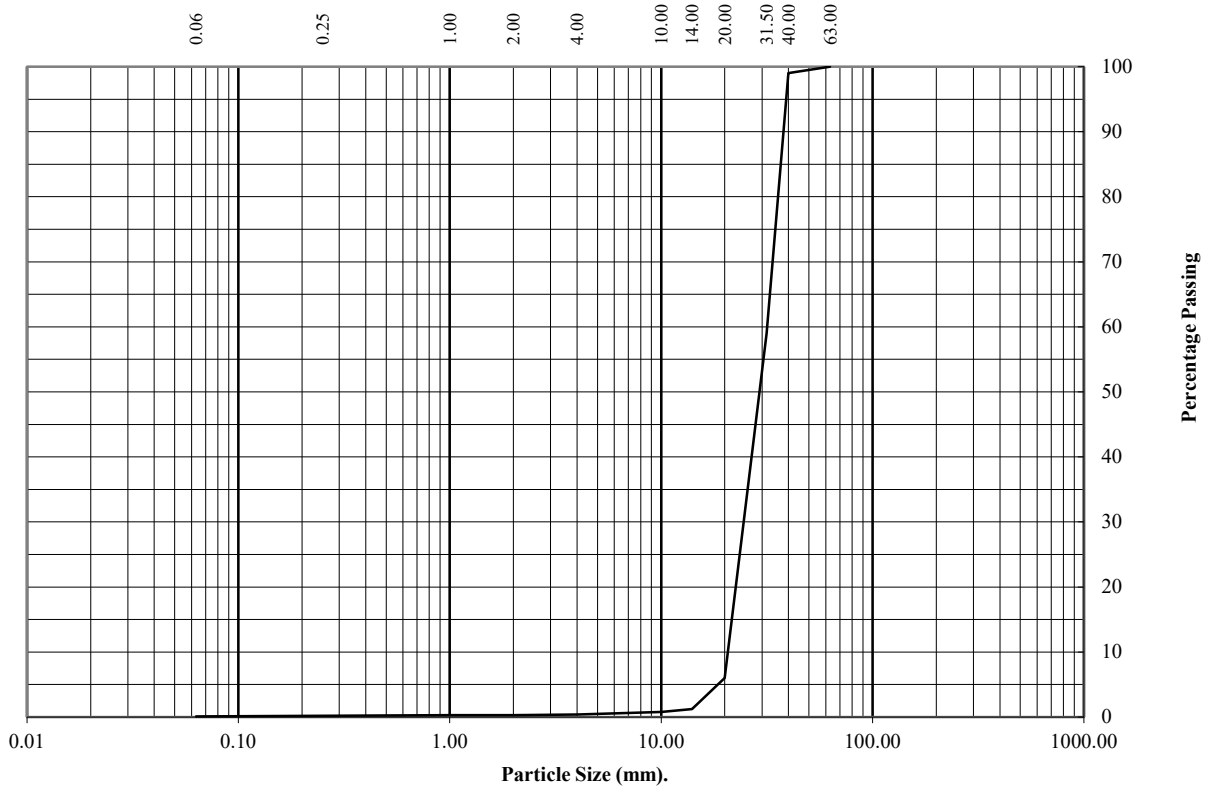

BS Test Sieve mm	Percentage Passing %	20/40mm	
		Lower	Upper
63	100	98	100
40	99	80	99
31.5	59	20	70
20	6	0	20
14	1		
10	1	0	7
4	0		
2	0		
1	0		
0.25	0		
0.063	0		

Remarks:



Port Salford

Contract No:

PSL23/5089

Client Ref No:

28/06/2023